


MAGNUM MS4024 or 4448PAE DUAL INVERTERS WITH 2 CLASSIC 200'S

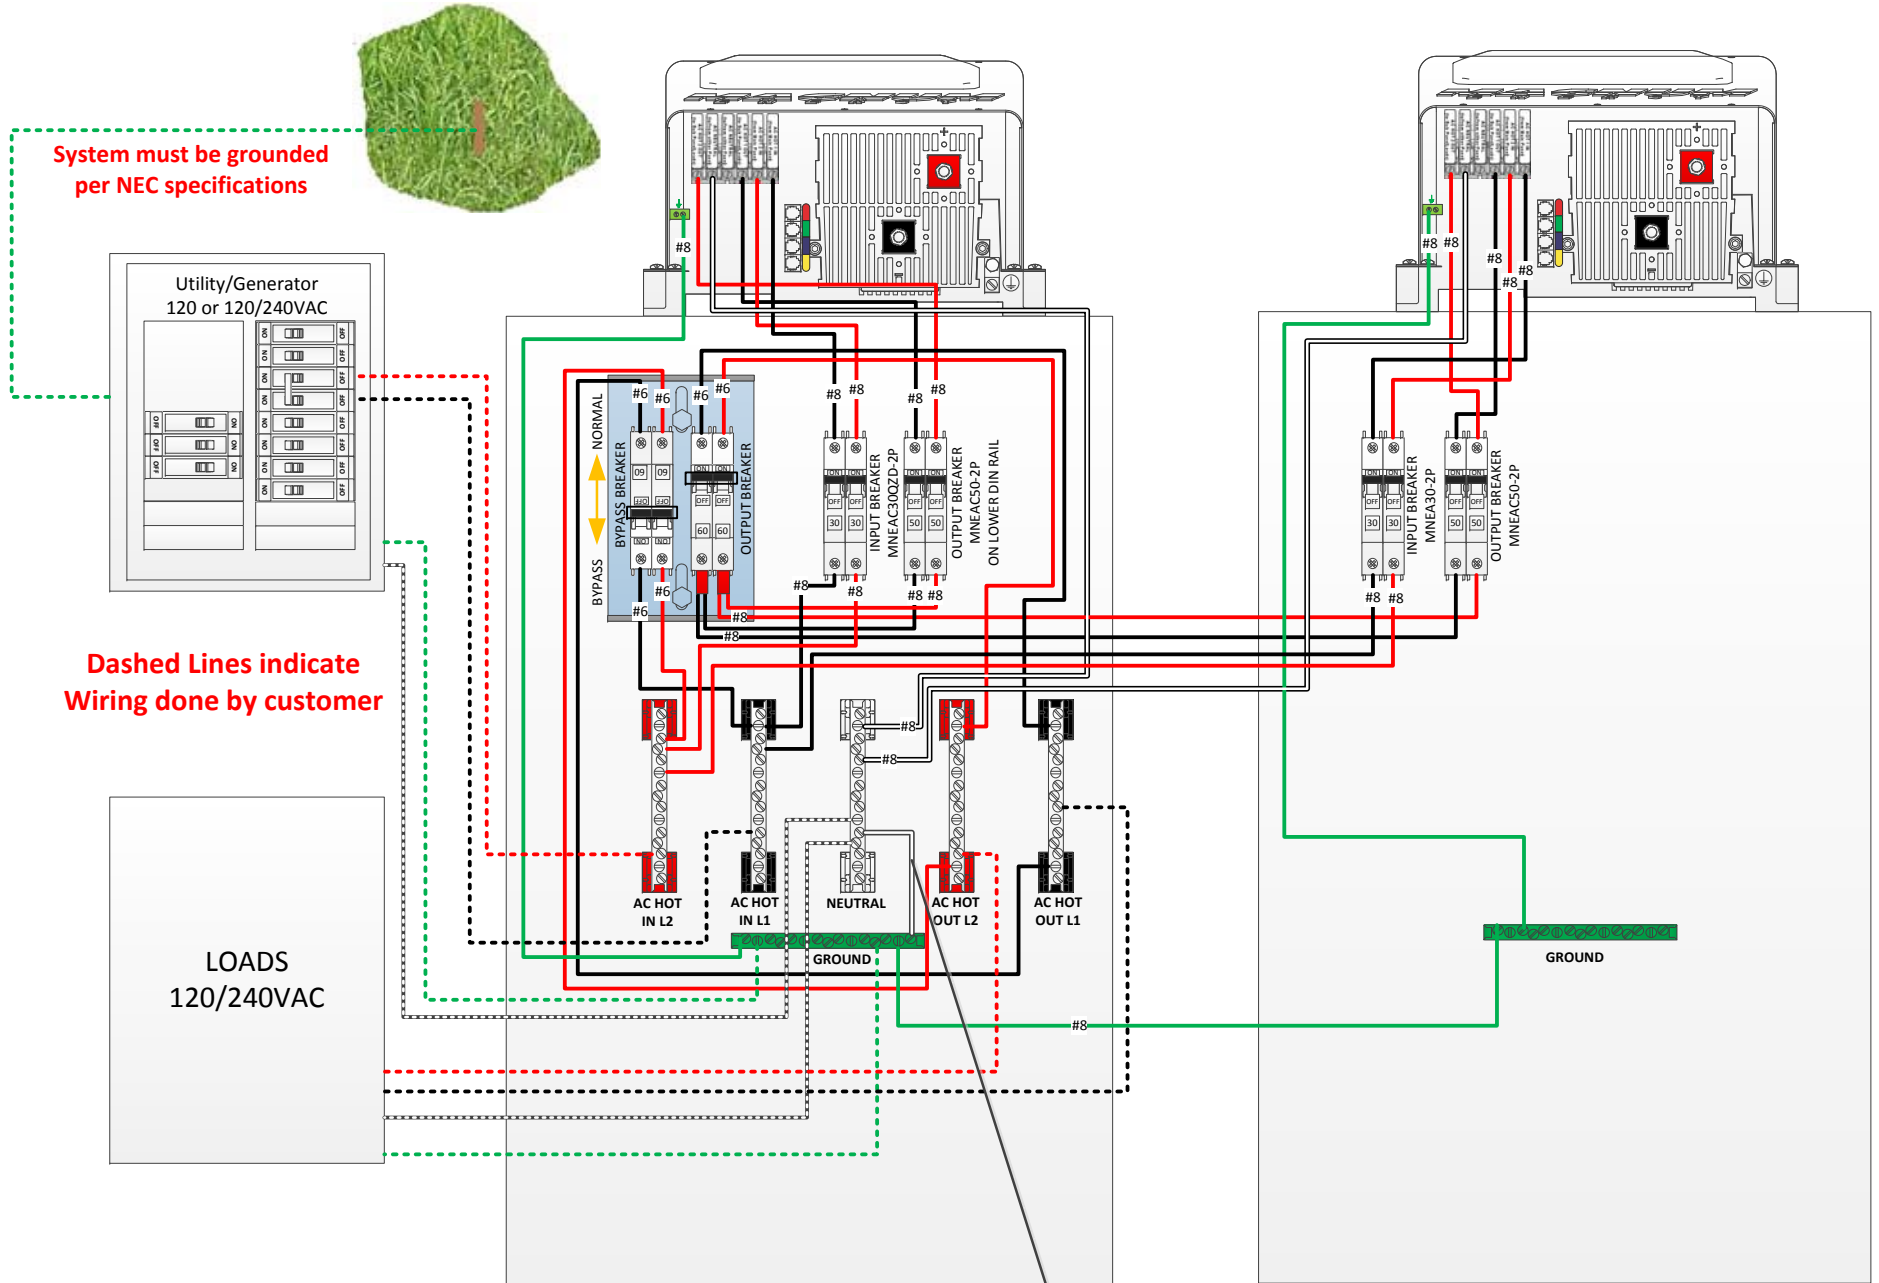



Customer should remove this wire if this is a grid connected home or if the AC neutral to ground bond is already made in the electrical system. If you are unsure please consult with your electrician.

MASTER

SLAVE

DC Wiring done by
MidNite Solar
Dashed Lines
indicates Field wiring
done by Customer

PV Array 1

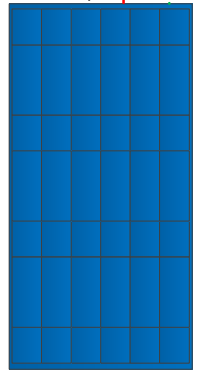
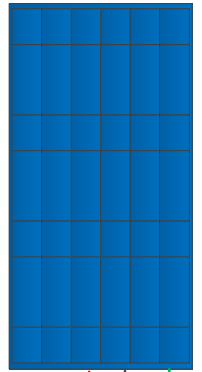


PV Array 2

All Midnite
installed Battery
cables are 2/0.
Customer should
use minimum of
4/0 cable to the
battery bank

USE A MNEDC250 for
the 4024PAE and the
MNEDC175 for the
4448PAE

48 Volt
Customer
supplied
battery bank

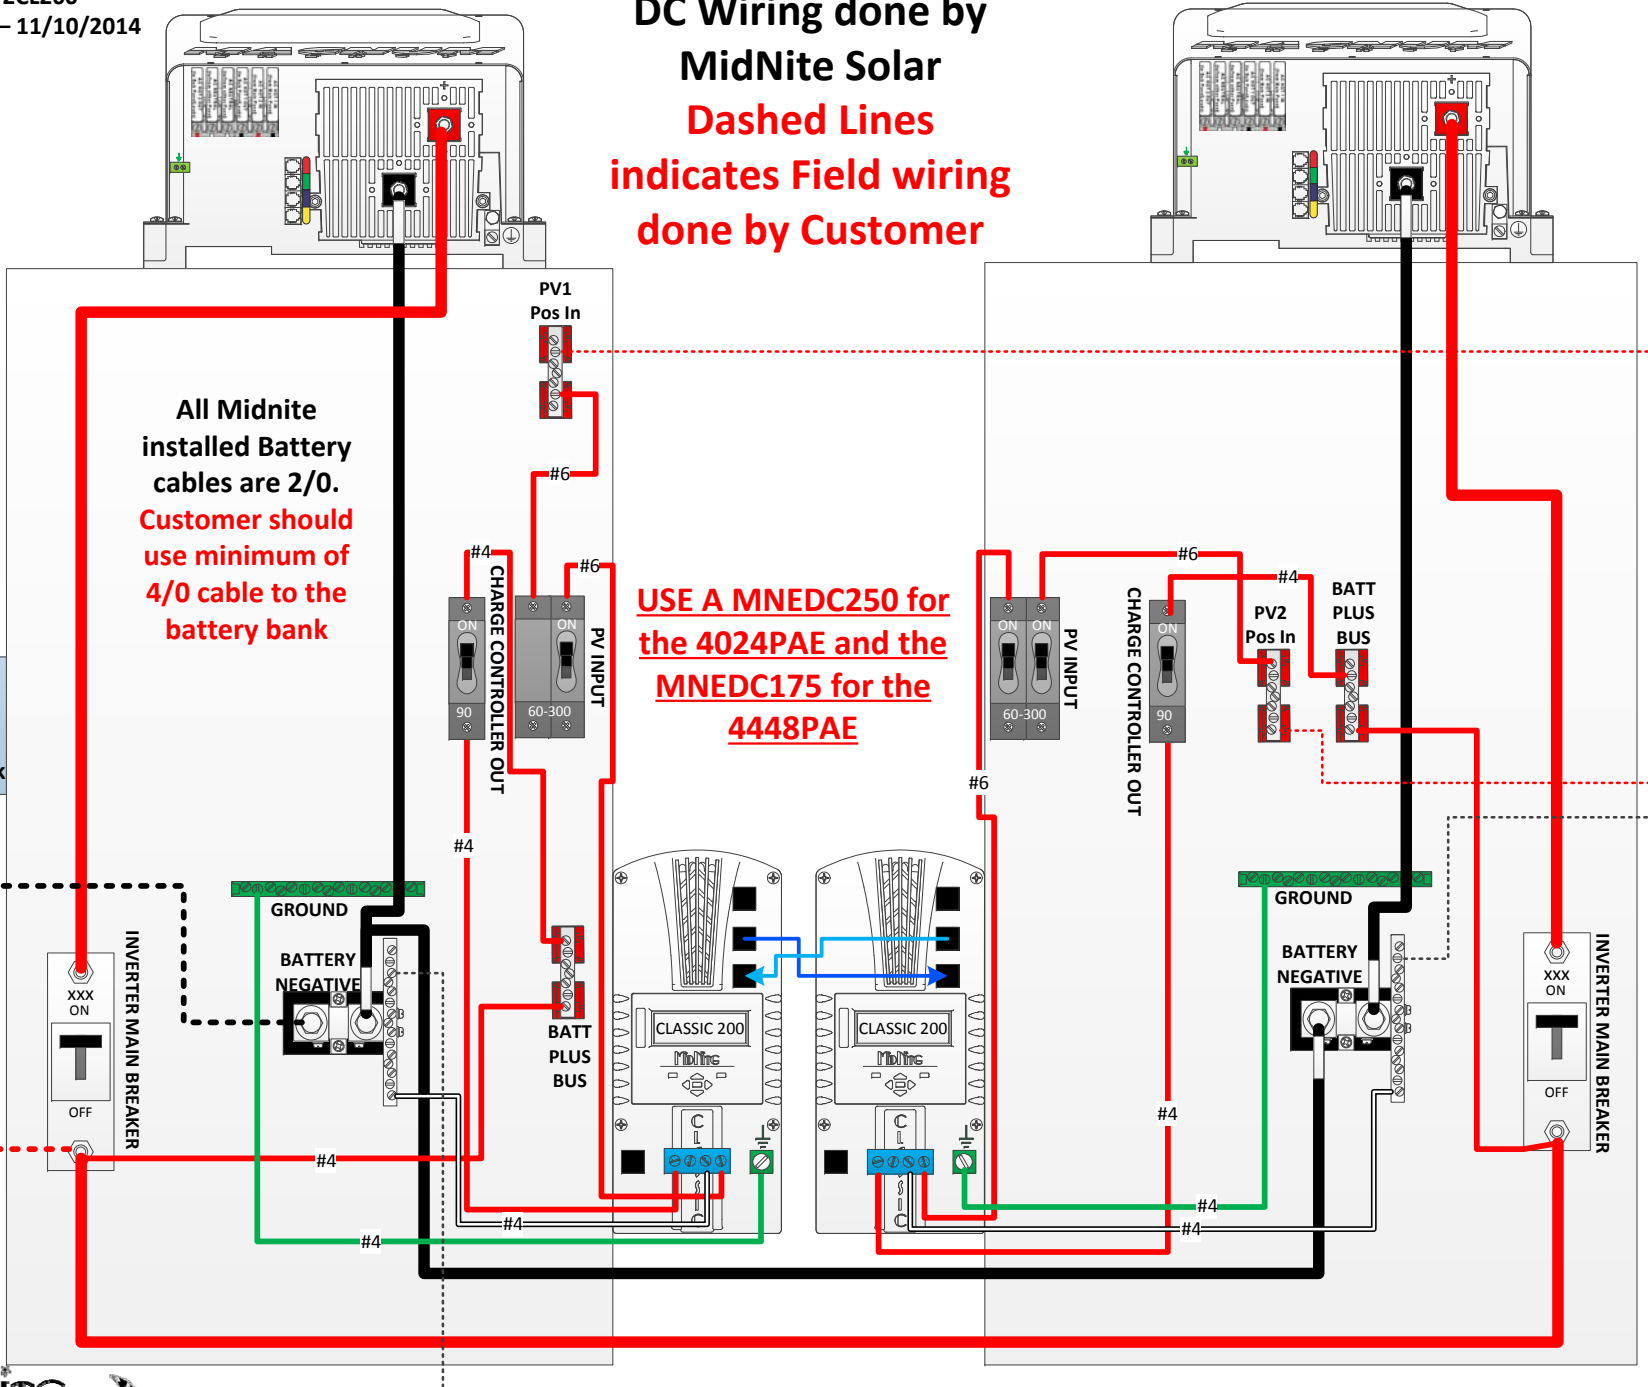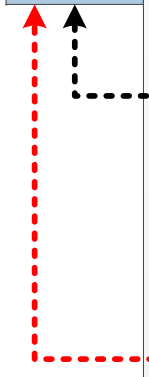

Communications cabling, BTS Cables, Surge Protection ETC

