



MNSI6048D-4CL200-RevA – 11/21/2016

AC WIRING INSTALLED BY MIDNITE SOLAR

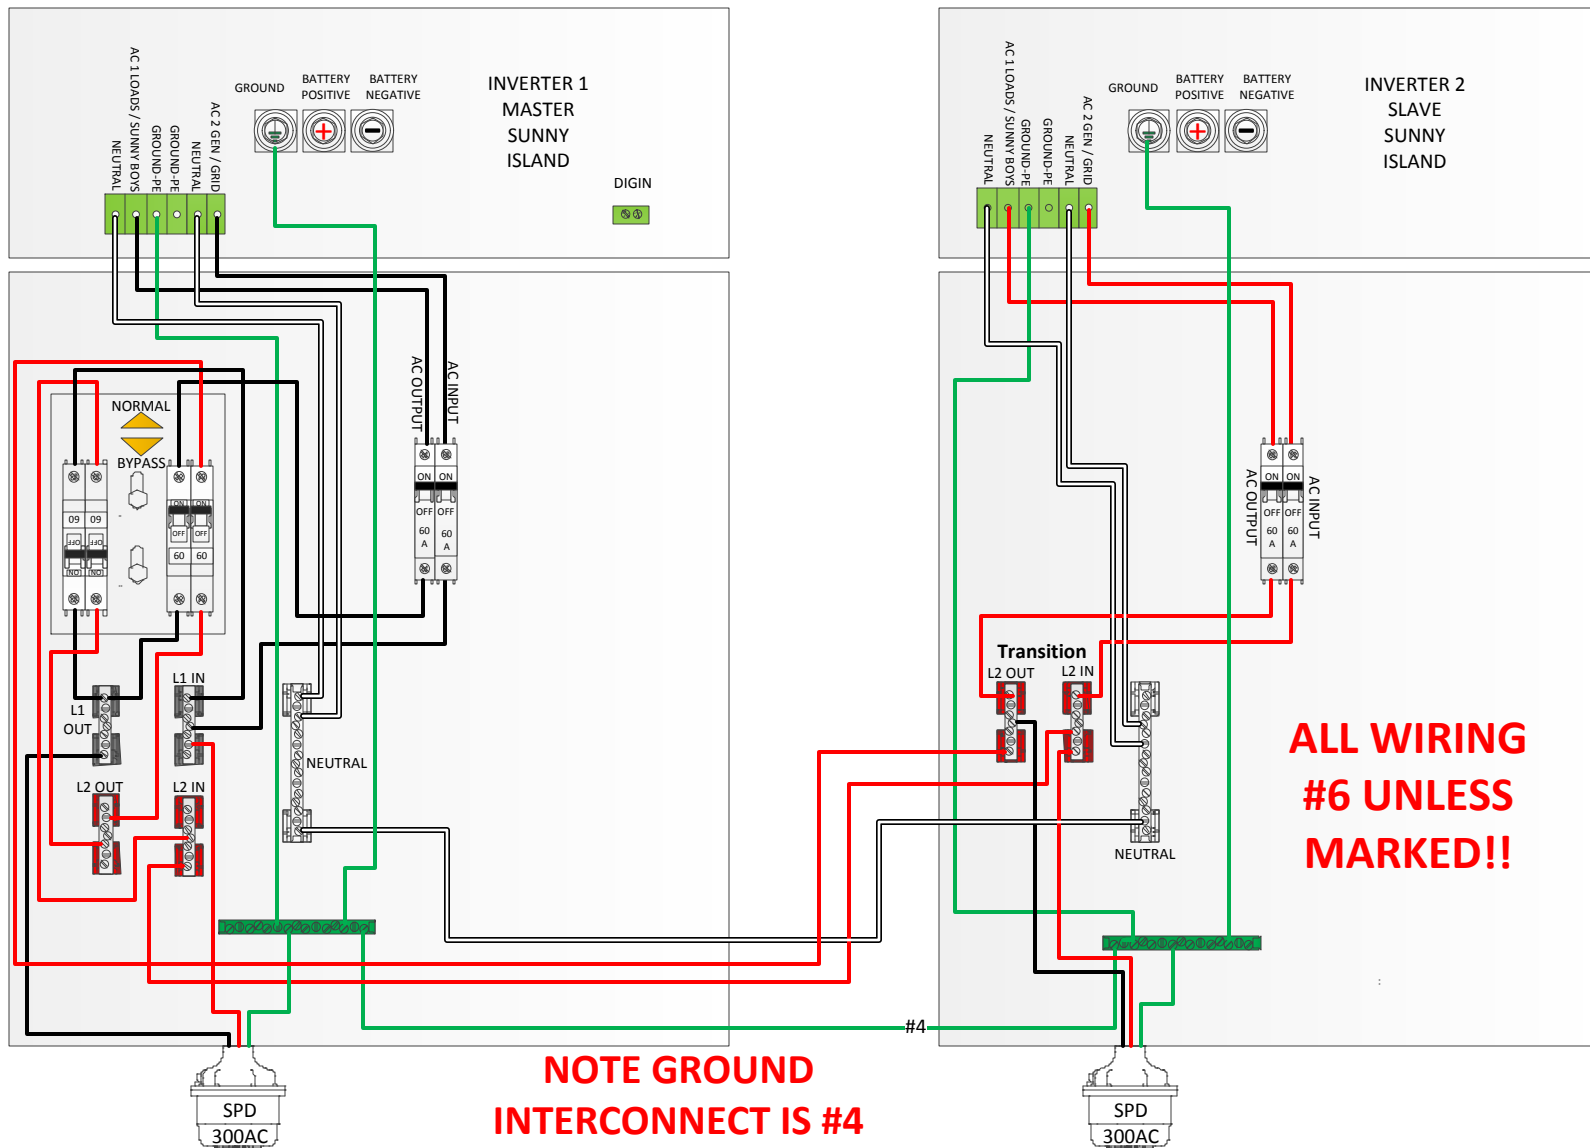

DC AND COMMUNICATION CABLES FACTORY INSTALLED BY MIDNITE SOLAR

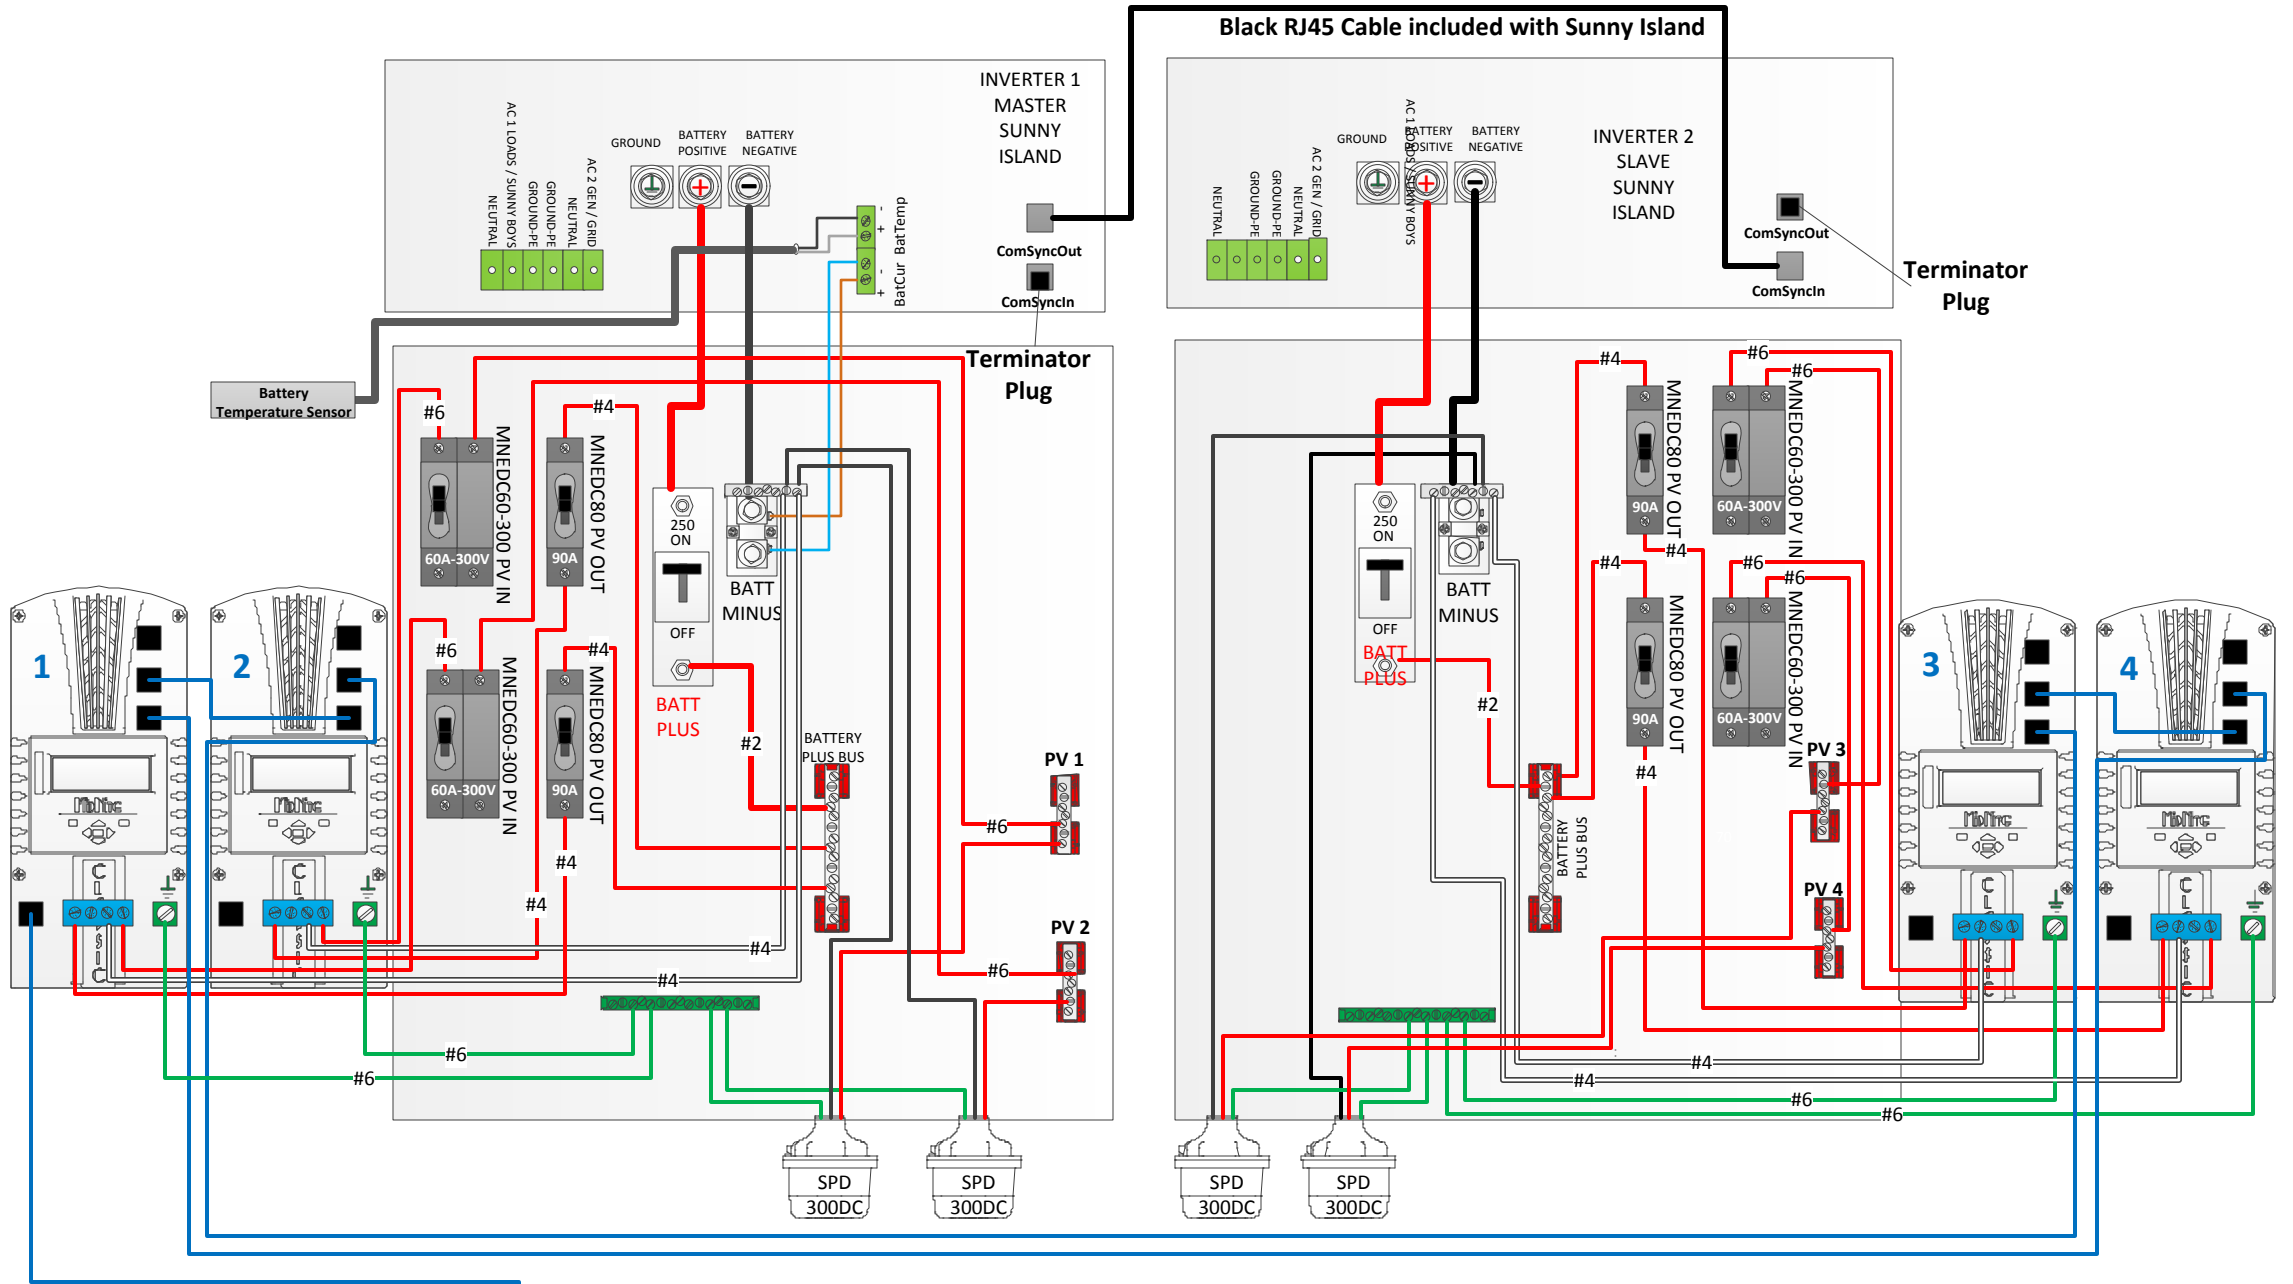


Battery Temp Sensor

MNSI6048D-4CL200-RevA – 11/21/2016

AC WIRING TO BE DONE BY CUSTOMER

System must be grounded per NEC specifications

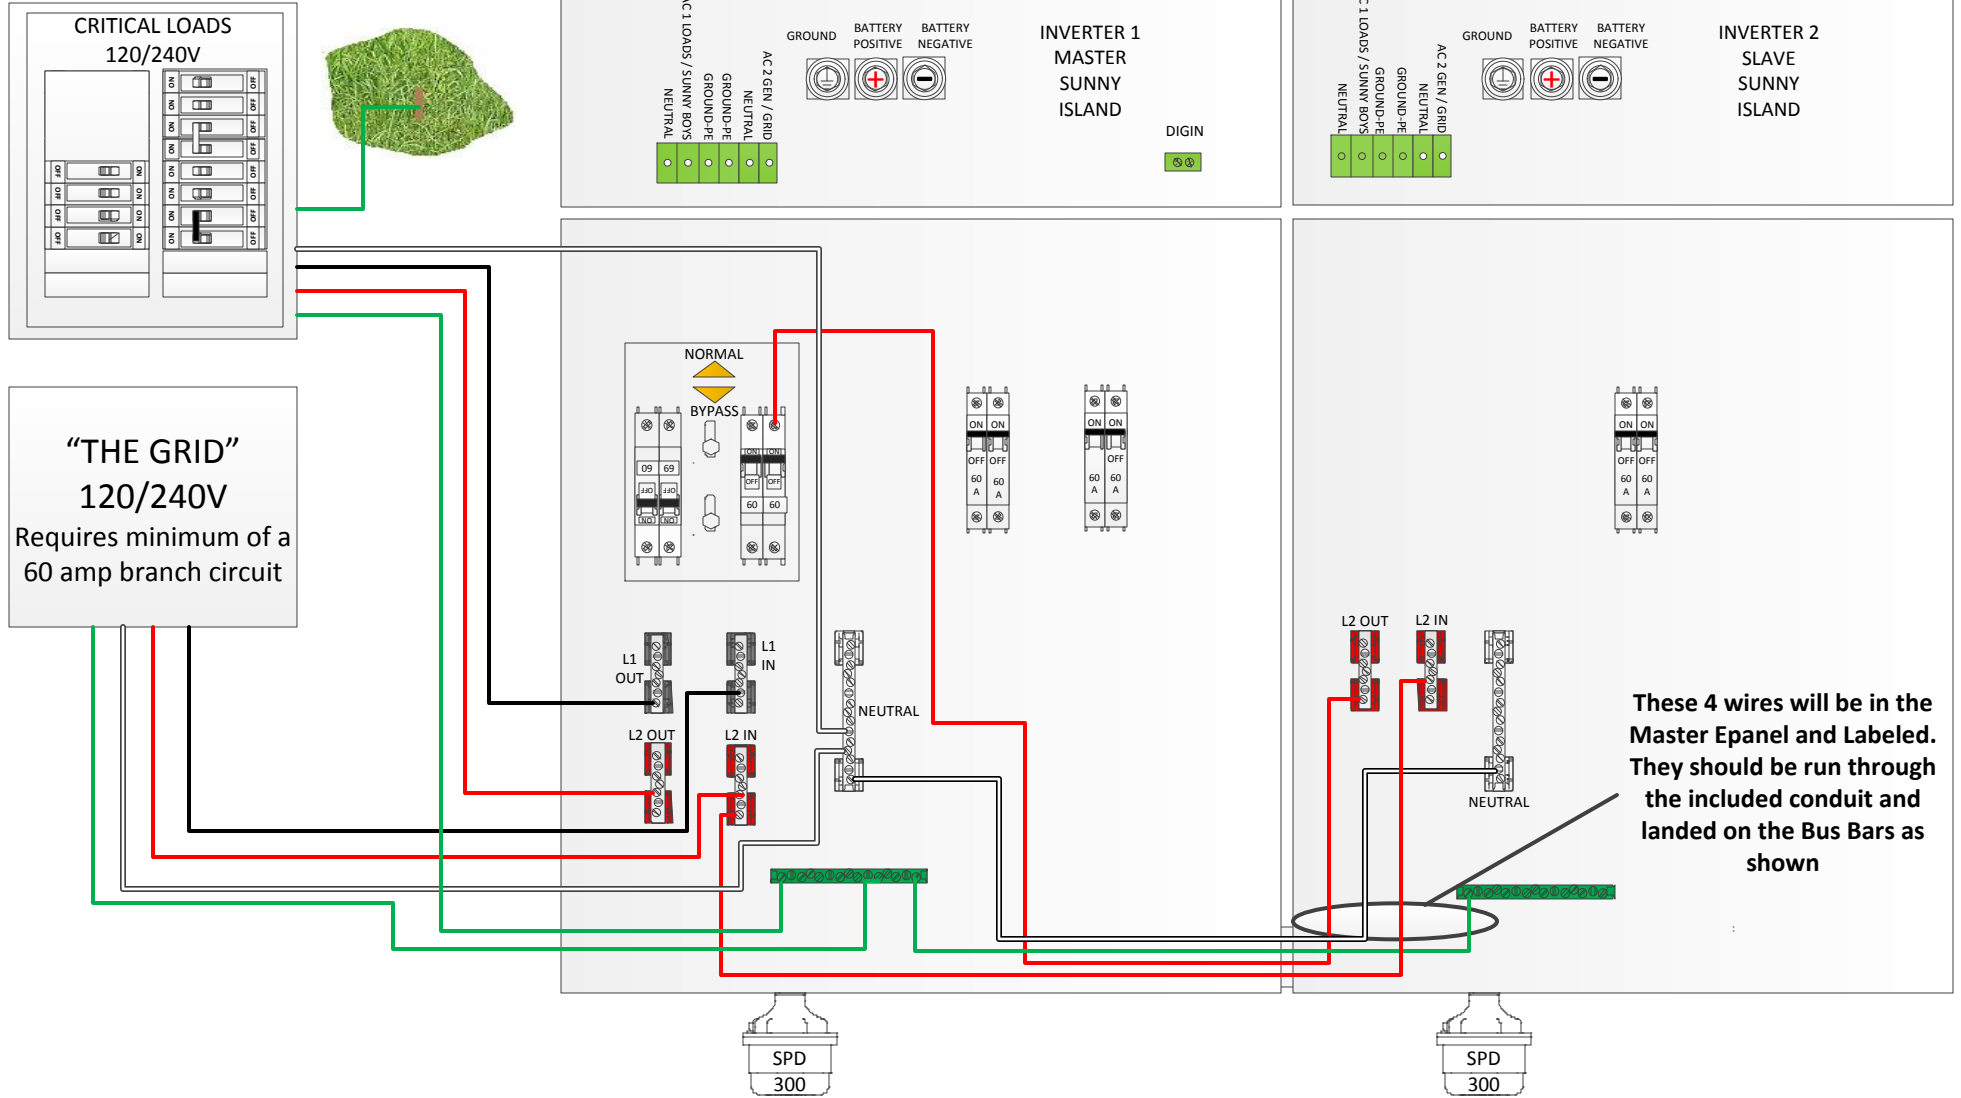

MNSI6048D-4CL200-RevA – 11/21/2016

CUSTOMER DC AND COMMUNICATIONS WIRING

