
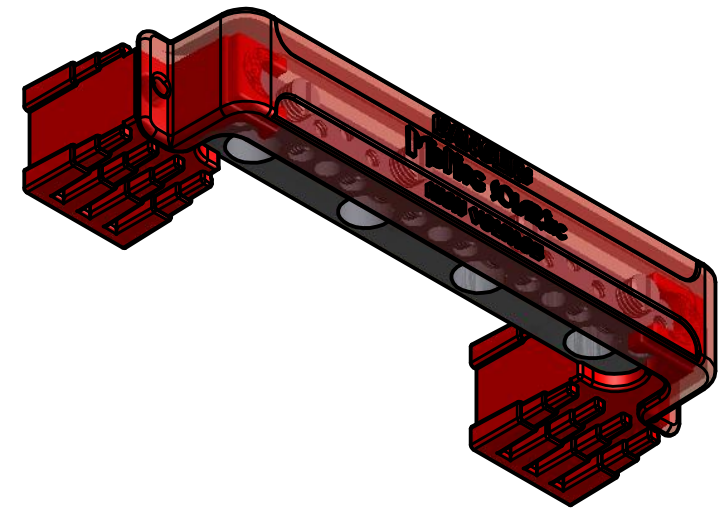
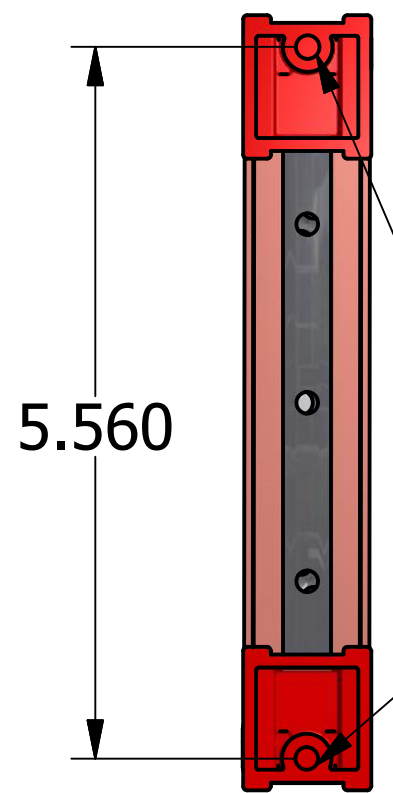


REVISION HISTORY			
REV.	DESCRIPTION OF CHANGE	DATE	SIGN

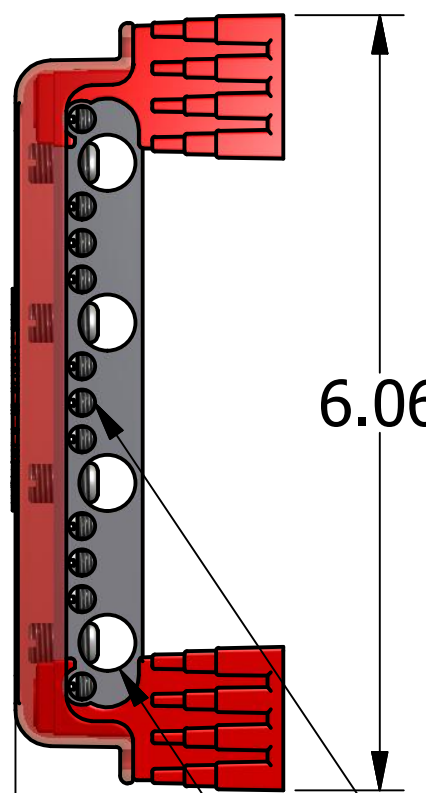

10-32 THREADED INSERT

14-6 AWG ELEVEN PLACES

2/0 AWG FOUR PLACES

**INSULATED BUSBAR**  
**250 AMP / 600 VOLT**  
 NYLON BASE, ABS SNAP ON COVER  
 UL & CSA 90C ALUMINUM & COPPER

<b>ALL TOLERANCES, UNLESS OTHERWISE STATED:</b> x.xxx=+/-0.005" x.xx=+/-0.01" x.x=+/-0.05" <b>ALL ANGLES = +/- 1° UNLESS OTHERWISE STATED</b>		DRAWN Robin	6/29/2014
MATERIAL:		CHECKED	
FINISH:		QA	
PROCESS:		MFG	
STANDARDS:		APPROVED	

<b>MIDNITE SOLAR, INC</b>			
TITLE <b>MidNite Solar</b>			
SIZE <b>B</b>	PROJECT: MNXX	DWG NO MNTBB2-15	REV
E-FILE:mntbb2-15.iam		SHEET <b>1</b> OF <b>1</b>	